




DDC4020e automation station

Application

Controller with BACnet communication

- Stand-alone station for closed-loop and open-loop control, optimizing and monitoring functions
- Customizable plain text for every parameter
- 4 DDC closed-loop control plants for ventilation or 8 DDC closed-loop control plants for heating, can be expanded with software objects
- PLC functions, free and as fixed macros (hardware objects)
- Software objects for increasing energy efficiency and energy optimization
- Communication
 - Via TCP/IP, Ethernet cable (min. Cat5, 10/100 Mbit) to enable use of the existing infrastructure
 - Built-in remote control via PC with browser without additional software or mobile end devices
 - Native BACnet in accordance with DIN EN ISO 16484-5, BACnet IP and BACnet MS/TP
 - BACnet Secure Connect (BACnet/SC) for secure communication between BACnet communication participants
 - Up to 99 DDC4000 automation stations with bidirectional data exchange
- 2 buses (CAN-based), configurable for switch cabinet bus or fieldbus for connecting fieldbus modules (FBM/FBU or RBW4xxx) or switch cabinet bus modules BMD/BMA or SBM
- Error message memory, event logging with date and time, incoming and outgoing messages are saved
- Forwards messages to GSM-SMS and e-mail.
- Trend value memory for max. 100.000 trend points.
- Configuration using modern, effective object structure, considerably reducing project planning time.
- Embedded Linux operating system for proven, stable use
- Constant system monitoring of the bus communication and all connected DDC components, bidirectional data exchange possible.

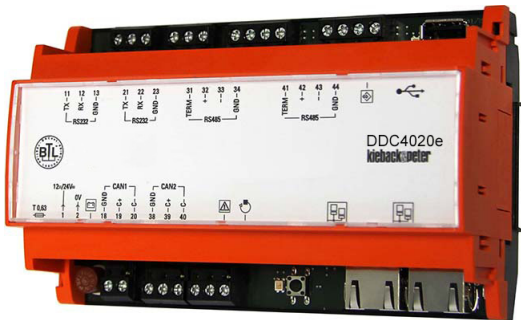

Content	Page
Important Information on Product Safety	2
Item	3
Technical Data	3
Dimensions	4
Accessories (included in delivery)	4
Accessories (not included in delivery)	4
Connection.....	5
Connectible modules	6
Installation.....	7
Mounting	8
Removal.....	8
Push buttons and LED displays	9



Important Information on Product Safety

Safety instructions

This document contains information on installing and commissioning the product “DDC4020e”. Each person who carries out work on this product must have read and understood this document. If you have any questions that are not resolved by this document, you can obtain further information from the supplier or manufacturer.

If the product is not used in accordance with this document, the protection provided could be impaired.

The applicable regulations must be observed when installing and using the devices. Within the EU, these include regulations regarding occupational safety and accident prevention as well as those from the VDE (German Association for Electrical, Electronic & Information Technologies). If the device is used outside of the EU, it is the responsibility of the plant engineer or operator to comply with local regulations.

Mounting, installation and commissioning work on the devices may only be carried out by qualified technicians. Qualified technicians are persons who are familiar with the described product and who can assess given tasks and recognize possible dangers based on their technical training, knowledge and experience, as well as their knowledge of the applicable regulations.

Symbol meanings



WARNING

Indicates a hazard of medium risk which can result in death or serious bodily injury if not avoided.



CAUTION

Indicates a hazard of low risk which can result in minor or medium bodily injury if not avoided.



CAUTION

Indicates a hazard which can result in material damage or malfunctions if not avoided.



NOTE

Indicates additional information that can simplify working with the product.



NOTES ON DISPOSAL

In accordance with the applicable laws and directives of the European Union countries, the product should not be disposed of with household waste. This ensures environmental protection and sustainable recycling or raw materials.

Private users should contact their local retailer or their local authority for information regarding environmentally safe recycling of old appliances. The local and currently valid legislation must be observed.

Commercial users should contact their supplier and observe the conditions of the purchase agreement. This device may not be disposed of together with other commercial waste.

Item

DDC4020e Top hat rail mounted automation station

Technical Data

Nominal voltage	■ 24V AC +/- 10 %; 50..60 Hz; 20 VA; 0,83 A or ■ DC 24 V +/- 10%; 13 W; 0.54 A or ■ 12V DC +/-10 %; 13 W; 1,08 A
Fuses	Time-delay power fuse, 0.63 A
Bus connection/interfaces	■ 2 Ethernet RJ45, internal, as switch Enables operation of up to 99 DDC4000 automation stations, users can establish worldwide network via active network components, BMS and BACnet client connection, 10/100 Mb/s, TCP/IP ■ 2 CAN buses, configurable as fieldbus or switch cabinet bus - Fieldbus; F-bus: up to 63 fieldbus modules FBM or up to 40 RBW4xxx, 2000 m, 20 kBd, CAN, see page 6 - Switch cabinet bus; SBM bus: up to 16 switch cabinet bus modules SBM or BMA/BMD, 200 m; 40 kBd, CAN, see page 6 ■ USB socket For USB stick only: Update, data backup/restoration ■ 2 serial RS232 - 1 for LON FTT-10 (terminals "11", "12", "13") - 1 for modem (terminals "21", "22", "23") ■ 2 RS485 - 1 for BACnet MS/TP (terminals "32", "33", "34"): 32 devices, 1000 m, up to 115 kBd, routing in accordance with BACnet/IP



CAUTION

Only connect USB memory sticks to the USB socket. Do not connect any other USB devices.



NOTE

Max. 63 fieldbus addresses or max. 16 switch cabinet bus addresses are managed on the two CAN buses.

The maximum number of connectible input/output modules depends on the selected device types. More information can be found in the DDC4000 project planning documentation.

Total memory	4 GB flash; 512 MB RAM
Operating system	Embedded Linux
Power failure data backup	No data loss in the event of a power failure
Real-time clock	6 months of backup power via capacitor in the event of a power outage
Overvoltage category	III
Rated impulse voltage	800V
Level of contamination	2
Method of operation	Type 1
Degree of protection	IP20




Product description

DDC4020e

Ambient temperature	0..55 °C (see installation note, p.7)
Ambient humidity	During operation: 20%..80% r.h., non-condensing Out of operation: 5% to 90% r.h., non-condensing
Mounting	Switch cabinet top hat rail TH 35-7.5 This device is intended for installation in a wall-mounted enclosure or switch cabinet with protection class I or II.
Dimensions	WxHxD 143,3 x 90 x 60 mm
Weight	0.26 kg

Dimensions

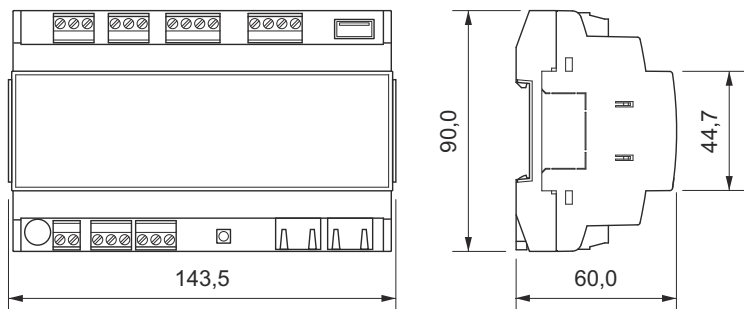

Accessories (included in delivery)


USBSTICK-DDC-MINI	USB stick
--------------------------	-----------

Accessories (not included in delivery)

DDC4N-LON	RS232-LON adapter
Data sheet 2.60-10.230-01 provides more information (included with the DDC4N-LON accessories).	



Connection

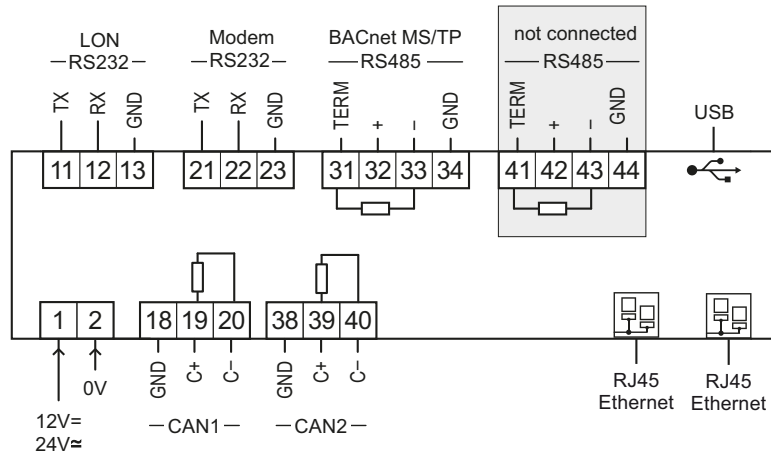

CAUTION

Ensure that no third persons can access your data during data transfer.
Only use secure solutions when connecting to public networks (VPN).



CAUTION

Use secure passwords to protect your data, devices and plants from unauthorized access. A secure password consists of lowercase and uppercase letters, numbers and special characters. It must also be long enough.

Change the passwords directly after transfer of the plant, commissioning of the device or importing software. Change the passwords at regular intervals. Use different passwords.

You are responsible for the security of your data and/or plant.



Product description

DDC4020e

Connectible modules

- Maximum number of installable fieldbus modules per automation station

Module	Number
FBG-FTL	16
FBK36	40
FBM018	63
FBM024	63
FBM034	63
FBM044	63
FBM18	63
FBM24	63
FBM34	63
FBM38	63
FBM44	63
FBM45	63
FBU410	30
MD200BUS	40
RBW420x	40
RBW430x	40

- Maximum number of installable switch cabinet bus modules per automation station

Module	Number
BMA4024	16
BMD4032	16
BMD4064	16
SBM41	16
SBM42	16
SBM45	16
SBM51/xx	5
SBM52/04	1

- Maximum number of universal bus modules that can be installed on the fieldbus or switch cabinet bus per automation stadium

Module	Number
BMA0804	48
BMA0004	63
BMA0600	63
BMD1204	36
BMD1200	48
BMD0004	63

Further information can be found in the DDC4000 project planning documentation.

Installation



CAUTION

Switching on the power supply of unparameterized products can lead to unforeseen consequences such as malfunctions or material damage.

Switch on the power only after the device has been configured by the commissioning technician.

CAN bus

When connecting the CAN bus, use a cable with 2 x 2 leads stranded into a pair with plastic insulation and electrostatic shielding with a lead diameter of at least 0.8 mm. Use a stranded pair of wires for the data lines (+ and -) and another free wire for the ground (0).

At the end of the CAN bus (furthest point from the controller), install a terminating resistor of about 180 ohms between the two data lines (+ and -). The terminating resistor is included with the controller.

- When using CAN bus as a fieldbus, the maximum cable length is 2,000 m.
- When using CAN bus as a switch cabinet bus, the maximum cable length is 200 m.
- Make sure to observe the line topology for the CAN bus.

RS485 for BACnet MS/TP

To connect the MS/TP bus, use at least one cable of the type JY(St)Y 2x2x0.8 Lg:

Two x two leads stranded into a pair with plastic insulation and electrostatic shielding with a lead diameter of at least 0.8 mm and a characteristic impedance between 100 and 130 ohms.

Use a stranded pair of leads for the data lines and another free lead for the ground connection.

Observe the polarity of the data lines of the MS/TP. Terminal "33" supplies the inverted signal, it is usually labeled with -. Terminal "32" supplies the non-inverted signal, it is usually labeled with +. Terminal "34" is used for the ground connection.

At the start and end of the MS/TP bus, install a terminating resistor of ideally about 120 ohm between the two data lines.

The DDC4020e has an integrated 120 ohm resistor. It can be activated by means of a bridge between the terminals "32" + and "31" TERM.

Foreign devices often enable a switchable terminating resistor. Refer to the data sheet or the respective manufacturer's manual for further information.

Use bias resistors to maintain the bus idle level at a defined high level and to prevent noise being misinterpreted as a data signal. We recommend that you use network bias resistors on the first and last device on the bus.

A maximum of 2 devices on the bus may be equipped with network bias resistors.

The DDC4000 is fitted with a 680 ohm bis resistor that can be activated via configuration. Further information can be found in the DDC4000 project planning documentation

Foreign devices often offer optionally switchable bias resistors.

- The maximum possible bus length is 1000 m.
- A maximum of 32 devices can be operated on a bus segment.
- Observe the line topology for the RS485 bus.



Mounting








WARNING

Contact with live parts of electrical domestic installation can cause death due to electric shock.
Mounting/removal may only be carried out when power is switched off.









CAUTION

If the device is installed in false ceilings, the maximum permitted ambient temperature is 45 °C.
Installation in floor boxes or similar systems is not permitted.




Removal





Push buttons and LED displays

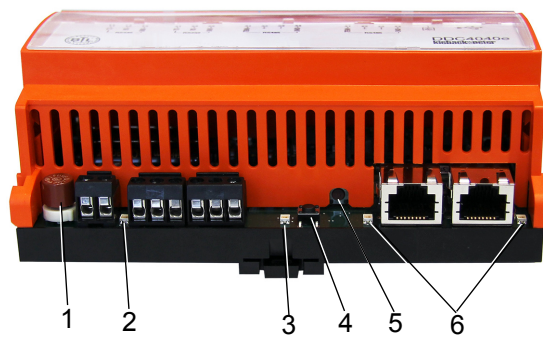

- (1) Mains fuse
- (2) Status LED nominal voltage
- (3) Status-LED internal data storage
- (4) Warm start push-button
- (5) Reset button
- (6) Status-LED Ethernet RJ45



Product description
DDC4020e