



DDC4002e Controller with Operator Function

Application

Color touchscreen with BACnet communication

- Standalone station with operator function for closed-loop and open-loop control, optimizing and monitoring functions
- Built-in touchscreen for intuitive, user-defined operation via plant structures which can be individually created
- Customizable plain text for every parameter
- Direct connection of the input and output signals
- 4 DDC closed-loop control plants for ventilation or 8 DDC closed-loop control plants for heating, can be expanded with software objects
- PLC functions, free and as fixed macros (hardware objects)
- Software objects for increasing energy efficiency and energy optimization
- Communication
 - Via TCP/IP, Ethernet cable (min. Cat5, 10/100 Mbit) to enable use of the existing infrastructure
 - Built-in remote control via PC with browser without additional software or mobile end devices
 - Native BACnet in accordance with DIN EN ISO 16484-5, BACnet IP and BACnet MS/TP
 - BACnet Secure Connect (BACnet/SC) for secure communication between BACnet communication participants
 - Up to 99 DDC4000 automation stations with bidirectional data exchange
 - Access to the entire DDC4000 automation system from every connected automation station (remote control) without additional devices
- 2 buses (CAN-based), configurable for switch cabinet bus or fieldbus for connecting fieldbus modules (FBM/FBU or RBW4xxx) or switch cabinet bus modules BMD/BMA or SBM
- Error message memory, event logging with date and time, incoming and outgoing messages are saved
- Forwards messages to printers, fax, GSM-SMS and e-mail.
- Trend value memory for max. 100.000 trend points.
- Configuration using modern, effective object structure, considerably reducing project planning time.
- Embedded Linux operating system for proven, stable use
- Backward-compatible with Kieback&Peter DDC3000 automation system
- Constant system monitoring of the bus communication and all connected DDC components, bidirectional data exchange possible.



Content	Page
Important Information on Product Safety	2
Item	3
Technical Data	3
Dimensions	6
Installation Dimensions	6
Accessories (included in delivery)	6
Accessories (not included in delivery)	6
Connection	7
Installation	9
Mounting	10



Important Information on Product Safety

Safety instructions

This document contains information on installing and commissioning the product “DDC4002e”. Each person who carries out work on this product must have read and understood this document. If you have any questions that are not resolved by this document, you can obtain further information from the supplier or manufacturer.

If the product is not used in accordance with this document, the protection provided could be impaired.

The applicable regulations must be observed when installing and using the devices. Within the EU, these include regulations regarding occupational safety and accident prevention as well as those from the VDE (German Association for Electrical, Electronic & Information Technologies). If the device is used outside of the EU, it is the responsibility of the plant engineer or operator to comply with local regulations.

Mounting, installation and commissioning work on the devices may only be carried out by qualified technicians. Qualified technicians are persons who are familiar with the described product and who can assess given tasks and recognize possible dangers based on their technical training, knowledge and experience, as well as their knowledge of the applicable regulations.

Symbol meanings



WARNING

Indicates a hazard of medium risk which can result in death or serious bodily injury if not avoided.



CAUTION

Indicates a hazard of low risk which can result in minor or medium bodily injury if not avoided.



CAUTION

Indicates a hazard which can result in material damage or malfunctions if not avoided.



NOTE

Indicates additional information that can simplify working with the product.



NOTES ON DISPOSAL

In accordance with the applicable laws and directives of the European Union countries, the product should not be disposed of with household waste. This ensures environmental protection and sustainable recycling or raw materials.

Private users should contact their local retailer or their local authority for information regarding environmentally safe recycling of old appliances. The local and currently valid legislation must be observed.

Commercial users should contact their supplier and observe the conditions of the purchase agreement. This device may not be disposed of together with other commercial waste.

Item

DDC4002e Controller with operator function

Technical Data

Nominal voltage	For automation station (terminals 1 and 21): ■ AC 24 V +/- 10%; 50 Hz..60 Hz; 22 VA; 1.0 A or ■ DC 24 V +/- 10%; 11 W; 0.45 A or ■ DC 12V +/- 10%; 11 W; 0.9 A For binary inputs and outputs (terminals 41 and 61): ■ DC 24V +/- 10%; 1.2 W; 0.05 A
Fuses	Time-delay power fuse, 3.15 A
Inputs and outputs	■ 32 BI/BO configurable, 8 BI (K1 to K8) for pulse counting up to 80 Hz - BO: Floating transistor output contact to 0 V = DC 24 V; 50 mA ■ 24 AIs/AOs can be independently configured as: - Analog output DC 0(2) V..10 V; max. 2.5 mA - Analog input See table "Sensor types", page 5 ■ Separate auxiliary power (terminal 16) DC 10 V; 50 mA for connecting external setting knobs
Bus connection / inter- faces	■ Ethernet RJ45 Enables operation of up to 99 DDC4000 automation stations, users can establish worldwide network via active network components, BMS and BACnet client connection, 10/100 Mb/s, TCP/IP ■ 2 CAN buses, configurable as fieldbus or switch cabinet bus Fieldbus; F-bus: up to 63 fieldbus modules FBM, FBU or RBW4xxx, 2000 m; 20 kBd, CAN Switch cabinet bus; up to SBM bus: 16 switch cabinet bus modules (SBM or BMA/BMD); 200 m; 40 kBd, CAN ■ USB socket (behind the front panel) just for USB memory stick: Update, backup/restoration ■ Serial RS232 Modem, fax, printer or remote control for DDC3000 automation station ■ RS485 for BACnet MS/TP: 32 devices, 1000 m, up to 115 kBd, routing in accordance with BACnet/IP



CAUTION

Only connect USB memory sticks to the USB socket. Do not connect any other USB devices.



NOTE

The RS232 or RS485 interface is activated by means of configuration.
Only one of the two interfaces can be used. The default setting is inactive.
You can find further information in the DDC4000 project planning documentation
Section "SY_Serial" Objects



Product Description

DDC4002e



NOTE

Max. 63 fieldbus addresses or max. 16 switch cabinet bus addresses are managed on the two CAN buses.

The maximum number of connectible input/output modules depends on the selected device types. More information can be found in the DDC4000 project planning documentation.

Displays	Touchscreen with active backlit ¼ VGA color active matrix LCD display 14 cm screen size (5.7 inch)
Memory	4 GB flash; 512 MB RAM)
Operating system	Embedded Linux
Power failure data backup	No data loss in the event of a power failure
Real-time clock	battery-buffered clock module, 7 years
Degree of protection	IP20
Overvoltage category	III
Rated impulse voltage	800V
Level of contamination	2
How It Works	Type 1
Ambient temperature	0 °C to 50 °C
Ambient humidity	During operation: 20% to 80% r.h., non-condensing Out of operation: 5% to 90% r.h., non-condensing
Housing	19" plastic short enclosure, quadruple enclosure with base and extra connections for Ethernet RJ45 and RS232 WxHxD: 202 x 132 x 137 mm
Front panel cutout	200.4 mm x 112.0 mm
Weight	1.15 kg
Label	CE

Sensor types

Sensor type	Measuring range
0(2) V..10 V	0%..100%
KP10	-50 °C..+150 °C
KP250	-50 °C..+150 °C
ML2	-50 °C..+150 °C
Ni100	-50 °C..+150 °C
Ni1000 (DIN)	-50 °C..+150 °C
Ni1000 (L&G)	-50 °C..+150 °C
NTC1,8K	-50 °C..+150 °C
NTC5K	-50 °C..+150 °C
NTC10K	-40 °C..+150 °C
NTC10KPRE	-50 °C..+150 °C
NTC20K	-30 °C..+150 °C
PT100	-100 °C..+850 °C
PT1000	-100 °C..+850 °C
Balco500	-40 °C..+150 °C
Satchwell DC1100	-20 °C..+120 °C
Satchwell DC1400	-40 °C..+120 °C
Resistor (potentiometer)	0..10 kΩ



NOTE


You can find more information on the sensor types in the “Temperature Sensor Tables” product description (1.10-90.100-01).




Product Description

DDC4002e

Dimensions

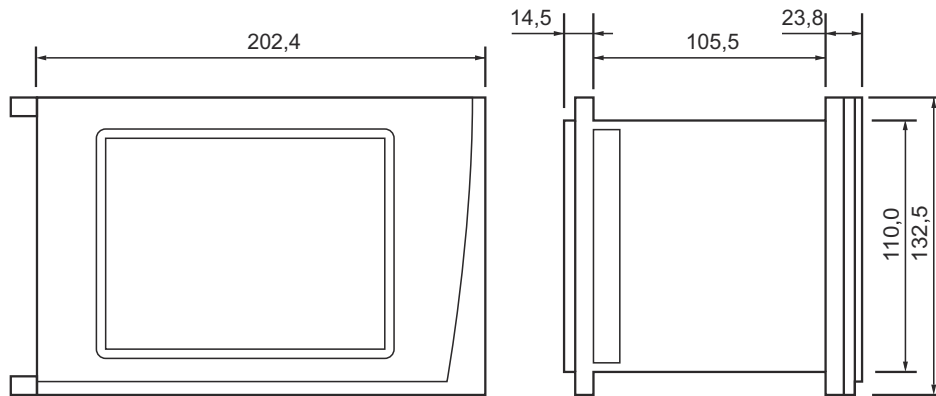

Installation Dimensions

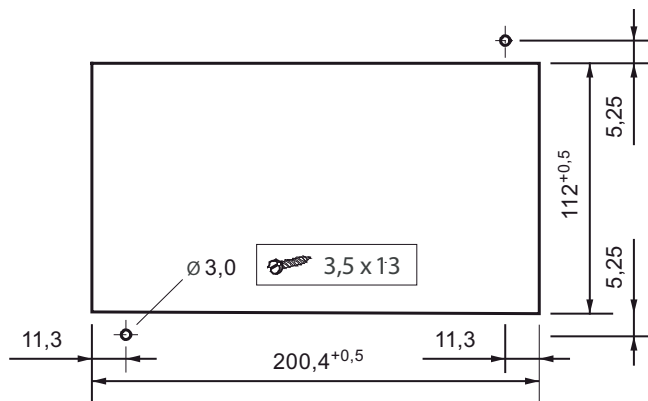

Accessories (included in delivery)


USBSTICK-DDC-MINI USB stick

Accessories (not included in delivery)

- Z23** Wall bracket for the DDC3000/DDC4000 automation station
Installation note 2.85-10.023-99 contains further information on the installation (included with accessory Z23).
- DDC4e-LON** RS232-LON adapter
Data sheet 2.60-10.220-01 provides more information (included with the DDC4e-LON accessories).



Connection

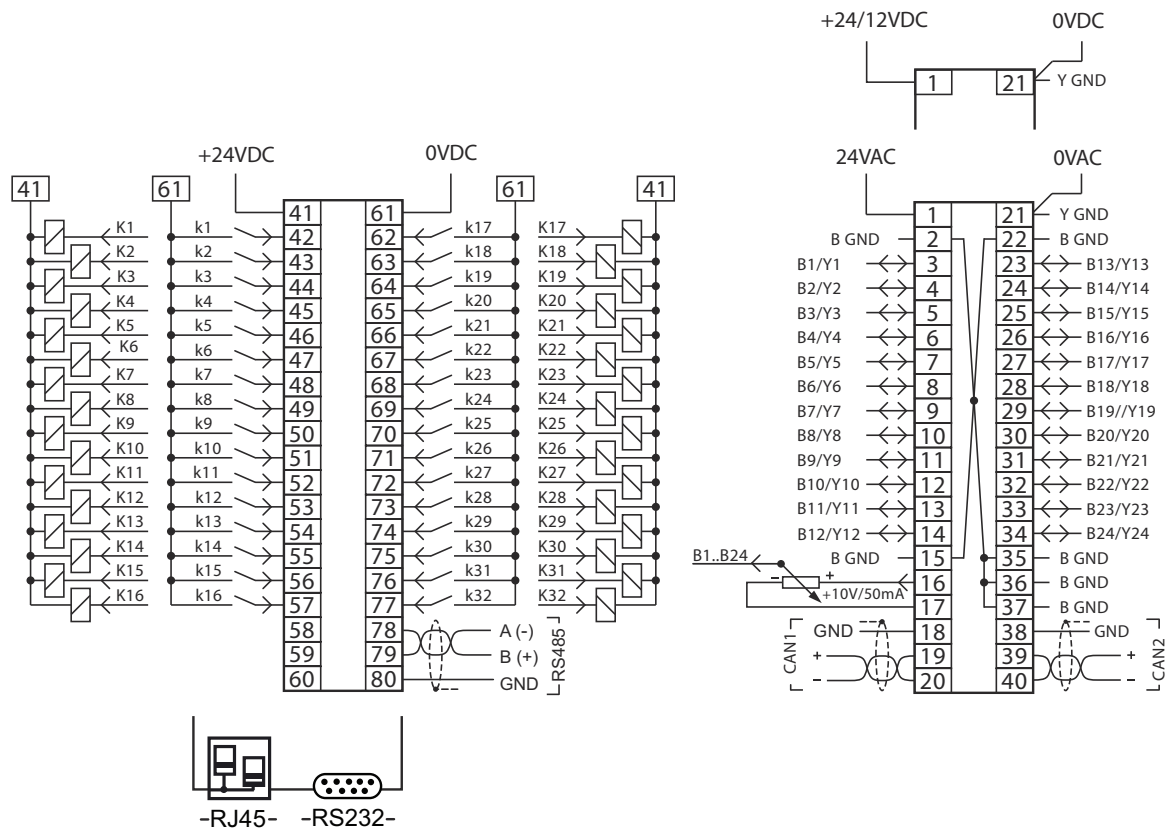

CAUTION

Always use separate power supply units for supplying power to the controller (terminals “1” and “21”) and the binary inputs and outputs (terminals “41” and “61”).



CAUTION

Ensure that no third persons can access your data during data transfer.
Only use secure solutions when connecting to public networks (VPN).



CAUTION


Use secure passwords to protect your data, devices and plants from unauthorized access. A secure password consists of lowercase and uppercase letters, numbers and special characters. It must also be long enough.

Change the passwords directly after transfer of the plant, commissioning of the device or importing software. Change the passwords at regular intervals. Use different passwords.

You are responsible for the security of your data and/or plant.



Sensor and actuator connection

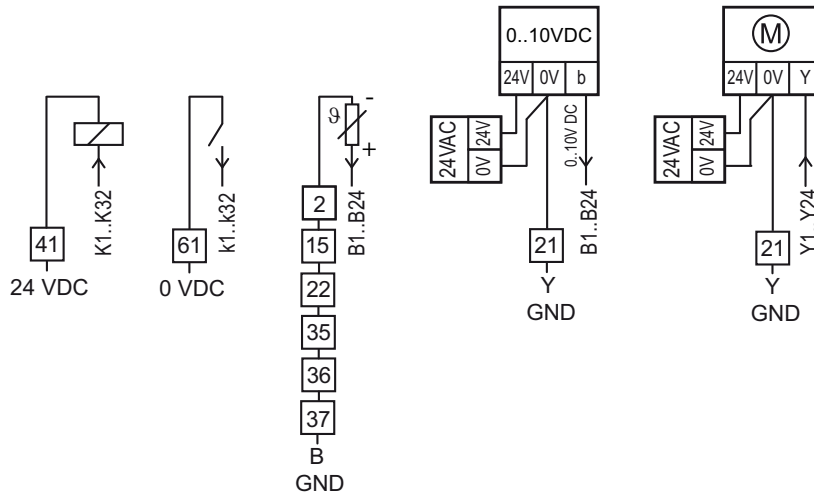

CAUTION

The GND wiring specified in the wiring diagram (Y GND, K GND, B GND) must be observed. Incorrect GND wiring may lead to errors in measurement.



CAUTION


A negative input voltage on a measuring channel leads to a significant influence on all inputs. All analog inputs (AI) have incorrect measured values.



NOTE

If negative input voltages are to be expected due to the sensor used (e.g. in en:air plants with the differential pressure transmitter DE23 from Fischer), appropriate measures must be taken to limit the input voltage outside the module.

Example: Use of a diode in the component plug and matching terminal block

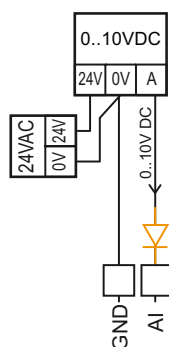

Diode: BAT86 (Schottky diode)
Component plug: Phoenix P-CO or equivalent
Terminal block: Phoenix PT 4-FSI/F GY or equivalent



Installation



CAUTION

Switching on the power supply of unparameterized products can lead to unforeseen consequences such as malfunctions or material damage.

Switch on the power only after the device has been configured by the commissioning technician.

CAN bus

When connecting the CAN bus, use a cable with 2 x 2 leads stranded into a pair with plastic insulation and electrostatic shielding with a lead diameter of at least 0.8 mm. Use a stranded pair of wires for the data lines (+ and -) and another free wire for the ground (0).

At the end of the CAN bus (furthest point from the controller), install a terminating resistor of about 180 ohms between the two data lines (+ and -). The terminating resistor is included with the controller.

- When using CAN bus as a fieldbus, the maximum cable length is 2,000 m.
- When using CAN bus as a switch cabinet bus, the maximum cable length is 200 m.
- Make sure to observe the line topology for the CAN bus.

RS485 for BACnet MS/TP

To connect the MS/TP bus, use at least one cable of the type JY(St)Y 2x2x0.8 Lg:

Two x two leads stranded into a pair with plastic insulation and electrostatic shielding with a lead diameter of at least 0.8 mm and a characteristic impedance between 100 and 130 ohms.

Use a stranded pair of leads for the data lines and another free lead for the ground connection.

Observe the polarity of the data lines of the MS/TP. Terminal "78" supplies the inverted signal, it is usually labeled with A (-). Terminal "79" supplies the non-inverted signal, it is usually labeled with B (+). Terminal 80 is used for the ground connection.

At the start and end of the MS/TP bus, install a terminating resistor of ideally about 120 ohm between the two data lines.

The DDC4000 is fitted with a 120 ohm terminating resistor that can be activated via configuration. Further information can be found in the DDC4000 project planning documentation

Foreign devices often enable a switchable terminating resistor. Refer to the data sheet or the respective manufacturer's manual for further information.

Use bias resistors to maintain the bus idle level at a defined high level and to prevent noise being misinterpreted as a data signal. We recommend that you use network bias resistors on the first and last device on the bus.

A maximum of 2 devices on the bus may be equipped with network bias resistors.

The DDC4000 is fitted with a 680 ohm bis resistor that can be activated via configuration. Further information can be found in the DDC4000 project planning documentation

Foreign devices often offer optionally switchable bias resistors.

- The maximum possible bus length is 1000 m.
- A maximum of 32 devices can be operated on a bus segment.
- Observe the line topology for the RS485 bus.









Mounting



WARNING

Contact with live parts of electrical domestic installation can cause death due to electric shock.
Mounting/removal may only be carried out when power is switched off.

Front installation



19" KA rack

